



Retaining airborne pathogens

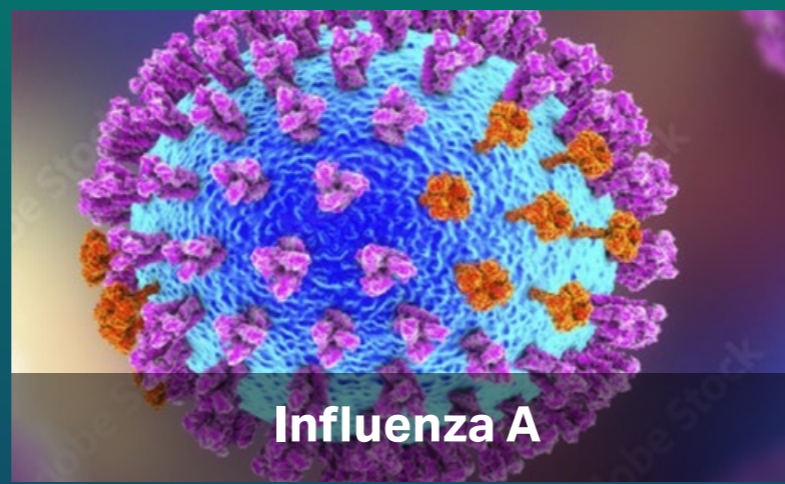

Pall Breathing System Filters have been shown in lab tests to retain airborne pathogens with **>99.999% efficiency¹**

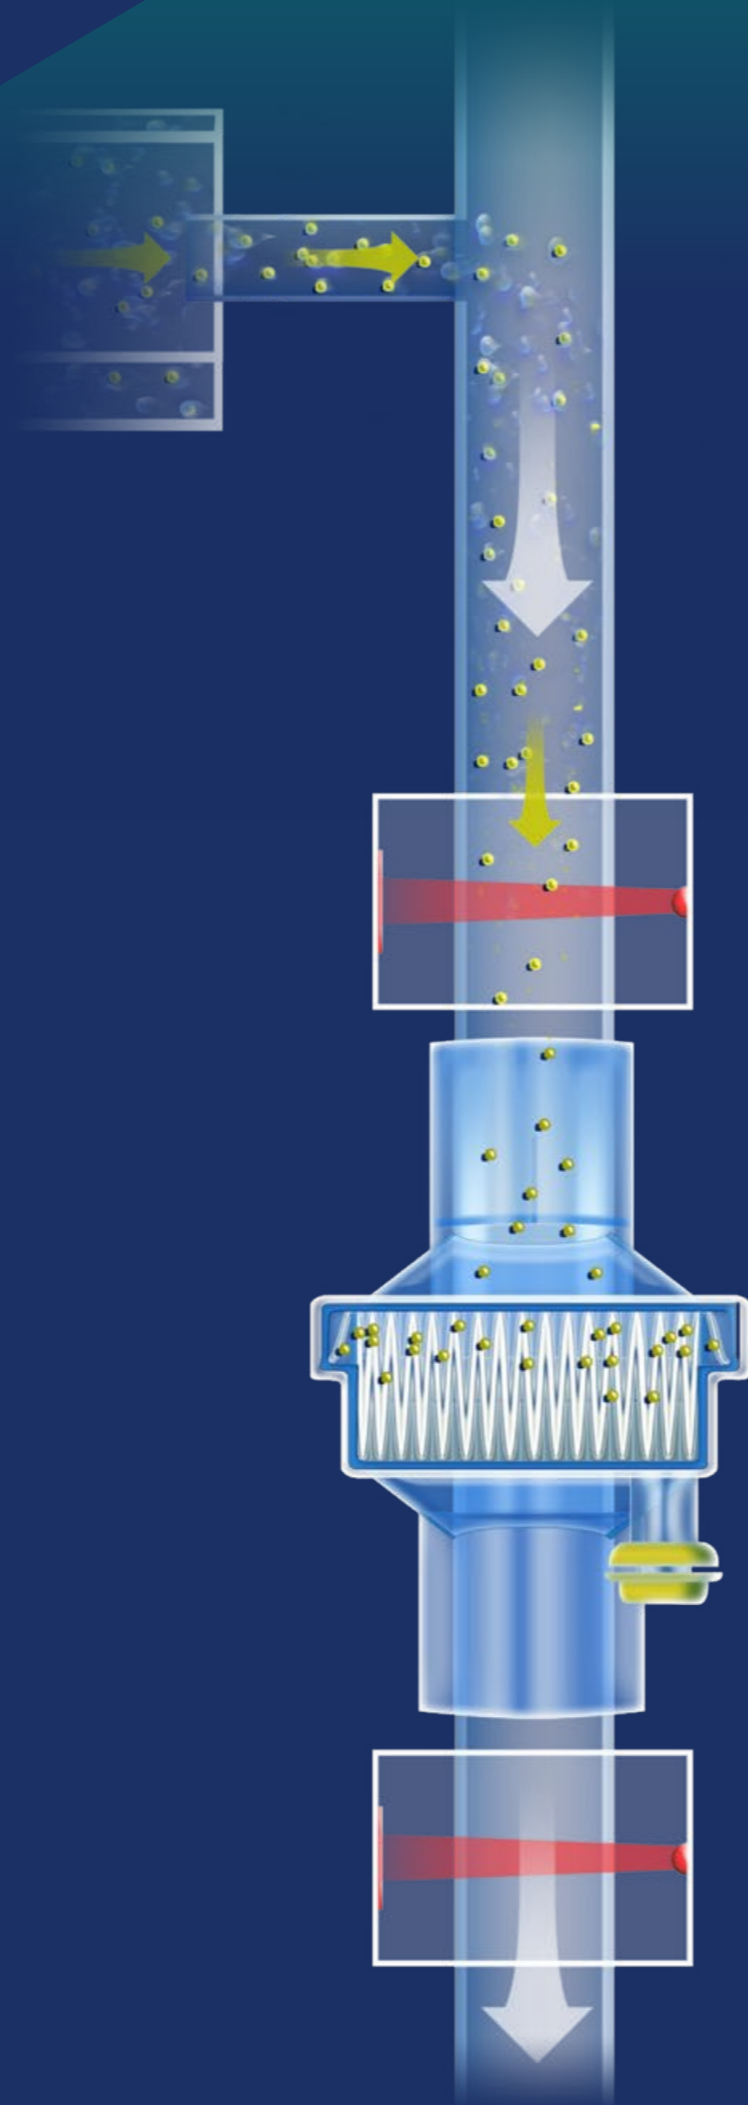

1. Pan L. Filtration Performance of Pall Breathing Circuit Filters. Pall Technical Report BCF2